


「GPS放射線モニタリング」プロジェクト結果

(1 / 1)

測定区分	線量率「GPS放射線モニタリング」プロジェクト	測定日	平成24年7月24日(火)
測定地区	田村市立古道小学校	測定時間	08:14～10:00
測定点	地上約1cm	測定者	橋本利重
測定器	Polimaster PM-1610、Polimaster PM-1610	記録作成	橋本利重・橋本重治
※Polimaster PM-1610は、(株)ト・ソリューションズ（022-342-8727）の提供協力品です。			

powered by [xls-hashimoto](#)

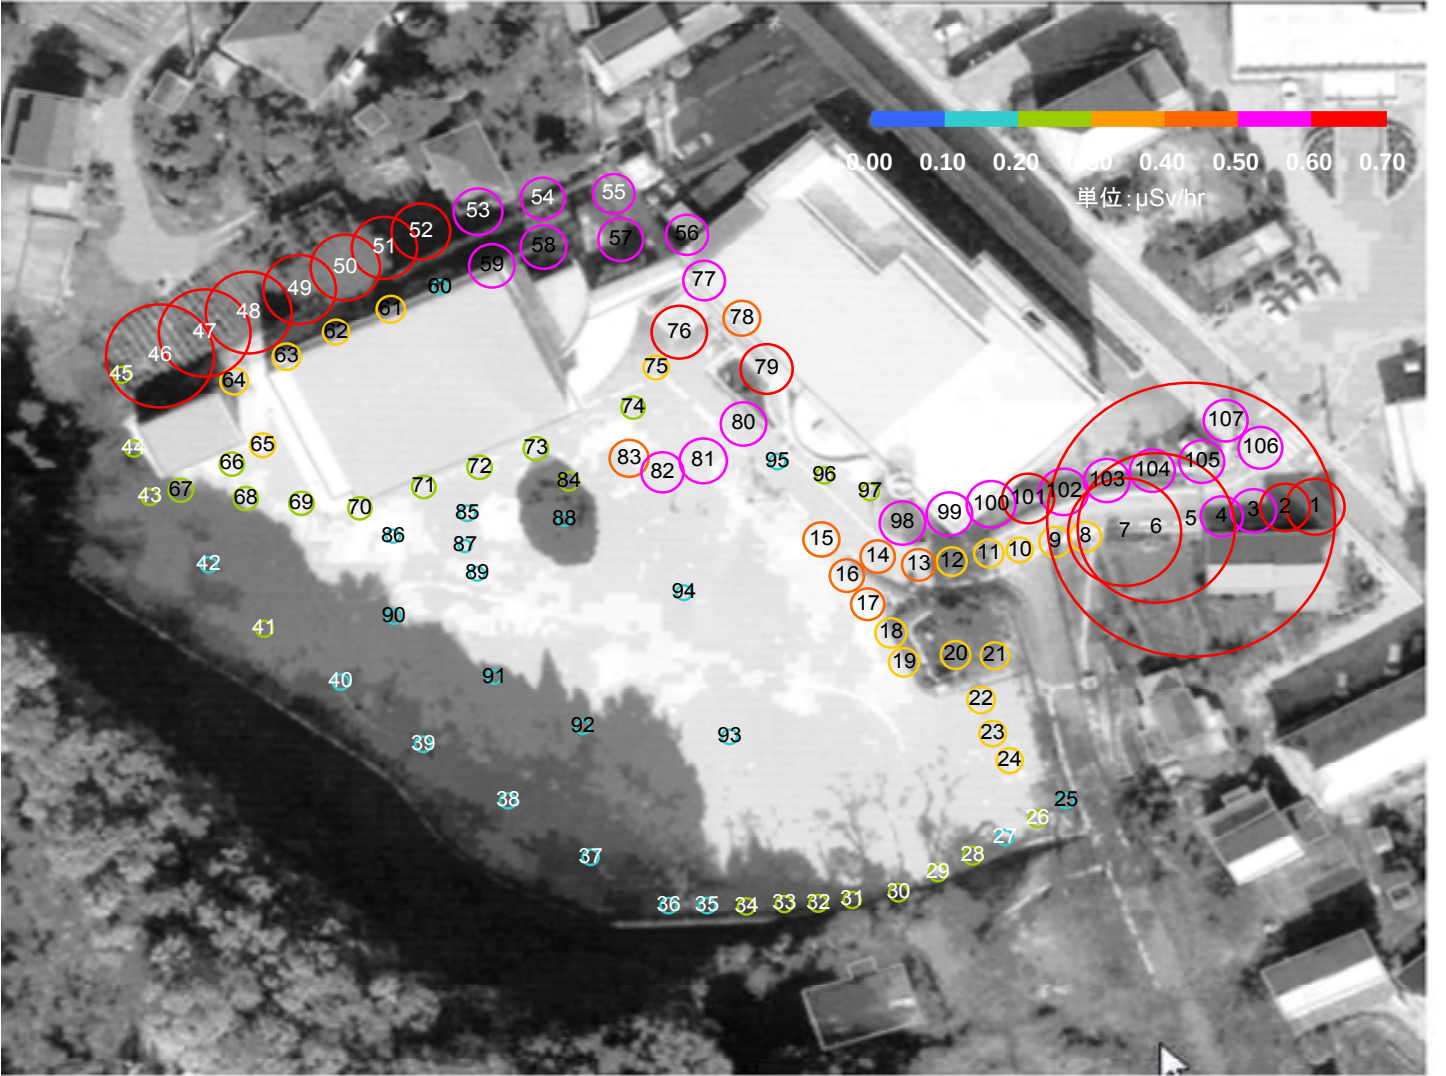

幾何平均線量率		No.1～No.155		0.37 × ÷ 1.79		No.1～No.107		0.37 × ÷ 1.79		単位: μ Sv/hr	
No	線量率	No	線量率	No	線量率	No	線量率	No	線量率	No	線量率
1	0.72	21	0.35	41	0.21	61	0.35	81	0.58	101	0.64
2	0.61	22	0.34	42	0.20	62	0.32	82	0.52	102	0.60
3	0.56	23	0.33	43	0.21	63	0.34	83	0.48	103	0.56
4	0.52	24	0.32	44	0.21	64	0.34	84	0.24	104	0.55
5	3.51	25	0.19	45	0.21	65	0.31	85	0.20	105	0.55
6	1.92	26	0.22	46	1.32	66	0.30	86	0.17	106	0.54
7	1.38	27	0.20	47	1.12	67	0.30	87	0.16	107	0.54
8	0.39	28	0.23	48	1.05	68	0.30	88	0.16	108	
9	0.39	29	0.22	49	0.89	69	0.30	89	0.18	109	
10	0.32	30	0.23	50	0.85	70	0.29	90	0.19	110	
11	0.36	31	0.21	51	0.80	71	0.29	91	0.18	111	
12	0.37	32	0.22	52	0.72	72	0.30	92	0.18	112	
13	0.41	33	0.21	53	0.60	73	0.30	93	0.19	113	
14	0.42	34	0.21	54	0.54	74	0.29	94	0.19	114	
15	0.44	35	0.20	55	0.51	75	0.31	95	0.20	115	
16	0.42	36	0.20	56	0.52	76	0.68	96	0.21	116	
17	0.41	37	0.20	57	0.55	77	0.51	97	0.22	117	
18	0.38	38	0.20	58	0.56	78	0.45	98	0.56	118	
19	0.37	39	0.20	59	0.56	79	0.64	99	0.56	119	
20	0.36	40	0.20	60	0.18	80	0.56	100	0.60	120	
										121	
										122	
										123	
										124	
										125	
										126	
										127	
										128	
										129	
										130	
										131	
										132	
										133	
										134	
										135	
										136	
										137	
										138	
										139	
										140	
										141	
										142	
										143	
										144	
										145	
										146	
										147	
										148	
										149	
										150	
										151	
										152	
										153	
										154	
										155	
										156	
										157	
										158	
										159	
										160	
										161	
										162	
										163	
										164	
										165	
										166	
										167	
										168	
										169	
										170	
										171	
										172	
										173	
										174	
										175	
										176	
										177	
										178	
										179	
										180	
										181	
										182	
										183	
										184	
										185	
										186	
										187	
										188	
										189	
										190	
										191	
										192	
										193	
										194	
										195	
										196	
										197	
										198	
										199	
										200	

単位: μ Sv/hr

コメント