


# 田村市都路町第7行政区放射線モニタリング結果

測定区分	除染前	測定日	平成24年7月29日（日）
測定地区	田村市立古道小学校	測定時間	9:00～12:00
測定点	1m	測定者	古道小PTA役員・教師
測定器	Polimaster PM-1610（1～33）,RA-1000（34～43） ※Polimaster PM-1405は、(株)ト・ソリューションズ（022-342-8727）の提供協力品です。	記録作成	古道小PTA役員・教師 <i>powered by xls-hashimoto</i>




幾何平均	除染前	0.25	x÷	1.29	除染後	x÷	再除染後	x÷	除染%									
No	除染前	除染後	除染%	再除染後	除染%	No	除染前	除染後	除染%	再除染後	除染%	No	除染前	除染後	除染%	再除染後	除染%	
1	0.25					21	0.21					41	0.24					118
2	0.44					22	0.31					42	0.23					119
3	0.30					23	0.31					43	0.29					120
4	0.28					24	0.28					101						121
5	0.28					25	0.30					102						122
6	0.24					26	0.21					103						123
7	0.29					27	0.17					104						124
8	0.26					28	0.21					105						125
9	0.26					29	0.16					106						126
10	0.18					30	0.31					107						127
11	0.30					31	0.26					108						128
12	0.32					32	0.23					109						129
13	0.29					33	0.13					110						130
14	0.19					34	0.15					111						131
15	0.34					35	0.31					112						132
16	0.27					36	0.22					113						133
17	0.32					37	0.24					114						134
18	0.26					38	0.40					115						135
19	0.16					39	0.33					116						136
20	0.26					40	0.25					117						137

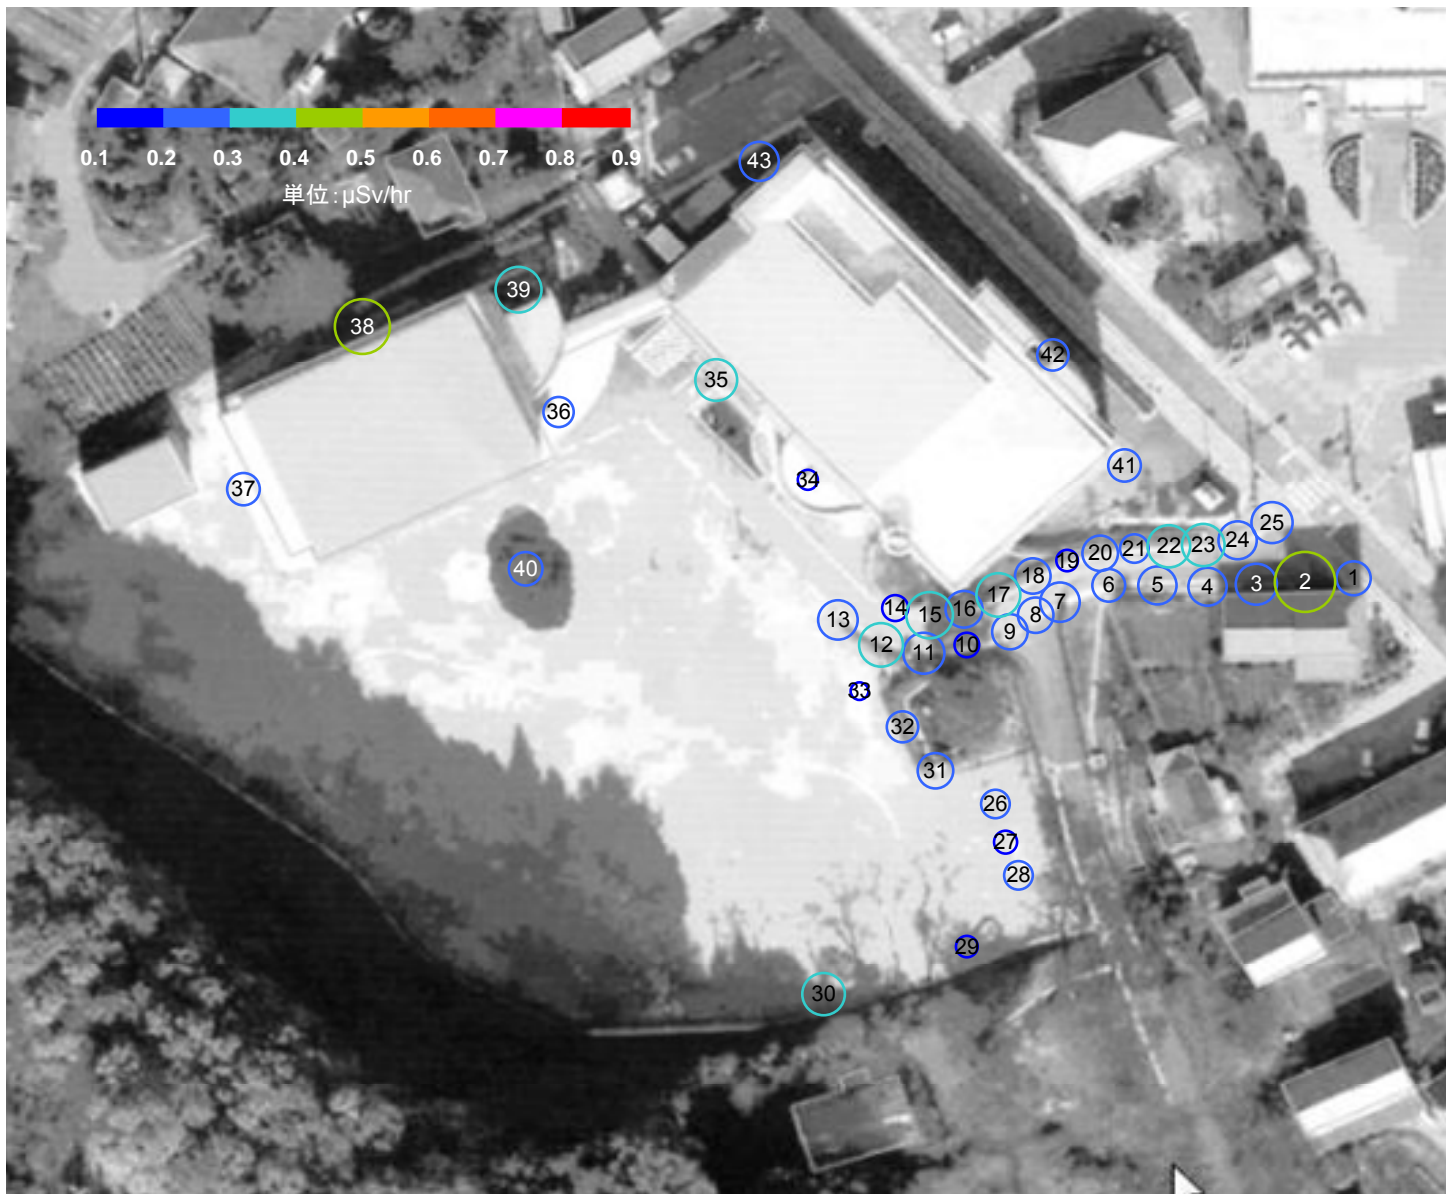

# 田村市都路町第7行政区放射線モニタリング結果

測定区分	除染前	測定日	平成24年7月29日 (日)
測定地区	田村市立古道小学校	測定時間	9:00~12:00
測定点	1cm	測定者	古道小PTA役員・教師
測定器	Polimaster PM-1610 (1~33) ,RA-1000 (34~43) ※Polimaster PM-1405は、(株)ト・ソリューションズ (022-342-8727) の提供協力品です。	記録作成	古道小PTA役員・教師 <small>powered by xls-hashimoto</small>

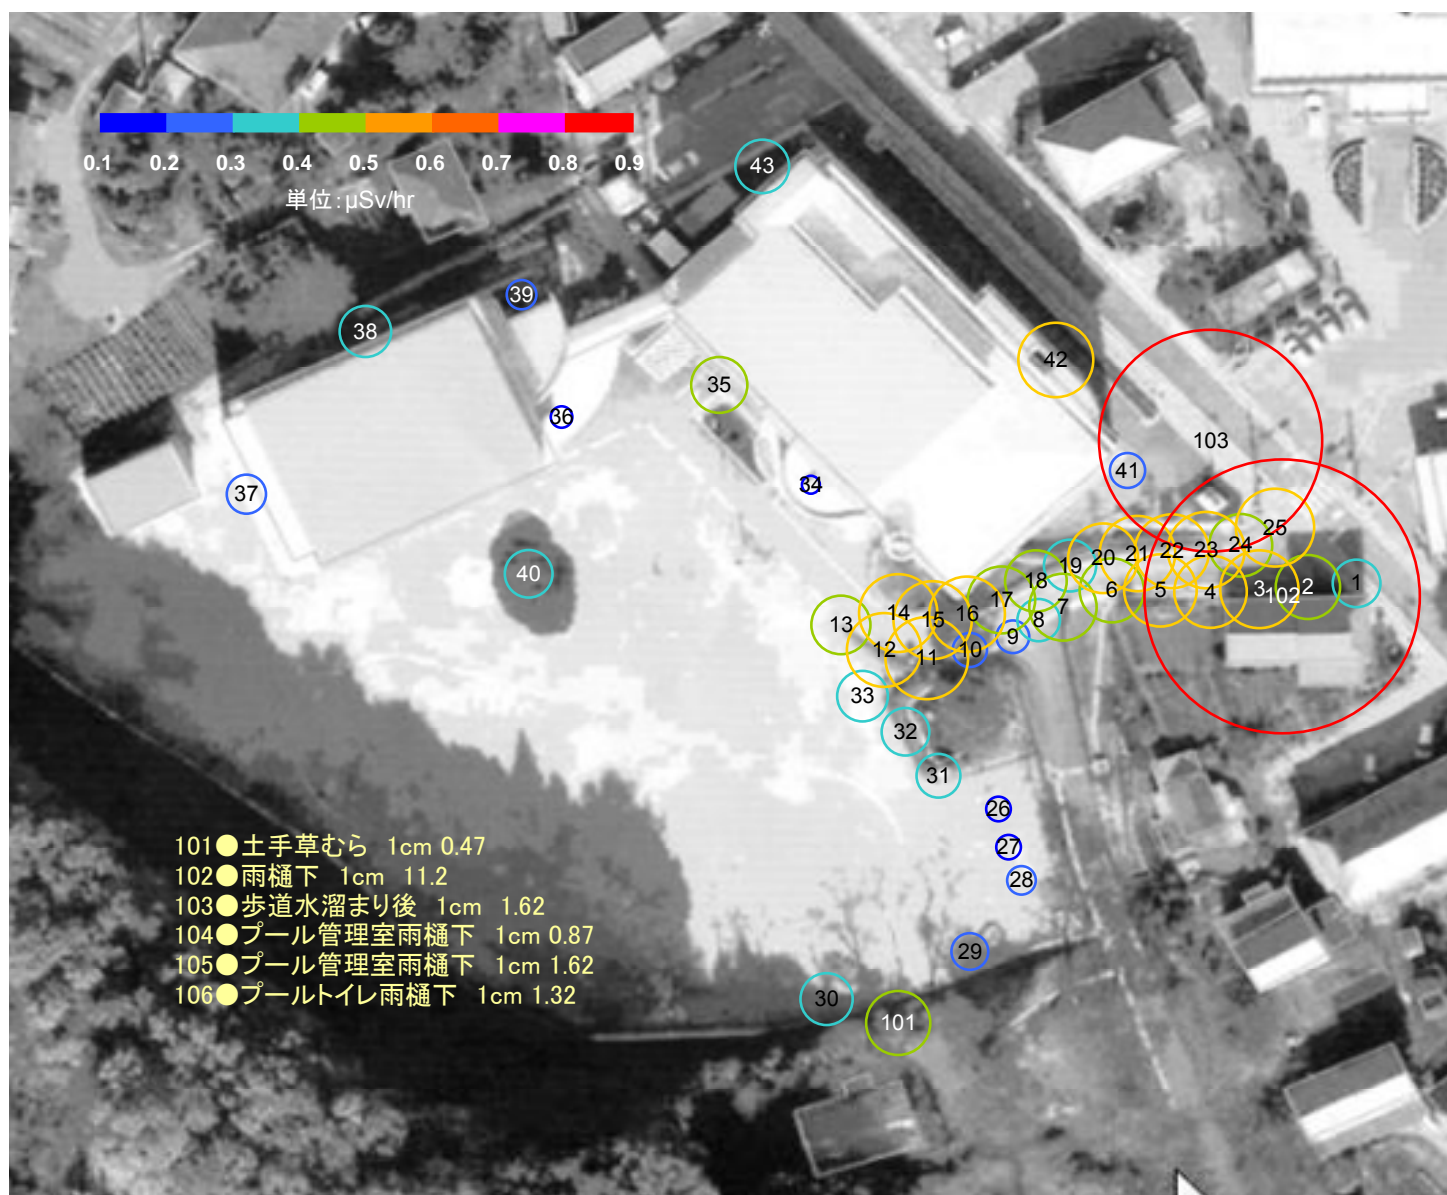

幾何平均		除染前		0.45		x ÷		2.01		除染後		x ÷		再除染後		x ÷		除染%					
No	除染前	除染後	除染%	再除染後	除染%	No	除染前	除染後	除染%	再除染後	除染%	No	除染前	除染後	除染%	再除染後	除染%	No	除染前	除染後	除染%	再除染後	除染%
1	0.35					21	0.55					41	0.26					118					
2	0.47					22	0.54					42	0.55					119					
3	0.57					23	0.56					43	0.39					120					
4	0.53					24	0.46					101	0.47					121					
5	0.53					25	0.57					102	11.20					122					
6	0.47					26	0.18					103	1.62					123					
7	0.49					27	0.18					104	0.87					124					
8	0.31					28	0.21					105	1.62					125					
9	0.24					29	0.27					106	1.32					126					
10	0.25					30	0.38					107						127					
11	0.60					31	0.32					108						128					
12	0.54					32	0.35					109						129					
13	0.43					33	0.37					110						130					
14	0.57					34	0.13					111						131					
15	0.57					35	0.41					112						132					
16	0.55					36	0.16					113						133					
17	0.49					37	0.29					114						134					
18	0.45					38	0.38					115						135					
19	0.38					39	0.22					116						136					
20	0.51					40	0.35					117						137					