


# 田村市都路町第7行政区放射線モニタリング結果

測定区分	除染前	測定日	平成24年7月29日(日)
測定地区	田村市立古道小学校	測定時間	9:00~12:00
測定点	1cm	測定者	古道小PTA役員・教師
測定器	Polimaster PM-1610 (1~33), RA-1000 (34~43) ※Polimaster PM-1405は、(株)ト・ソリューションズ (022-342-8727) の提供協力品です。	記録作成	古道小PTA役員・教師 <i>powered by xls-hashimoto</i>



幾何平均		除染前	0.37 x ÷ 1.89		除染後	x ÷		再除染後	x ÷		除染%
No	除染前	除染後	除染%	再除染後	除染%	No	除染前	除染後	除染%	再除染後	除染%
1	0.35					21	0.55				
2	0.47					22	0.54				
3	0.57					23	0.56				
4	0.53					24	0.46				
5	0.53					25	0.57				
6	0.47					26	0.18				
7	0.49					27	0.18				
8	0.31					28	0.21				
9	0.24					29	0.27				
10	0.25					30	0.38				
11	0.60					31	0.32				
12	0.54					32	0.35				
13	0.43					33	0.37				
14	0.57					34	0.13				
15	0.57					35	0.41				
16	0.55					36	0.16				
17	0.49					37	0.29				
18	0.45					38	0.38				
19	0.38					39	0.22				
20	0.51					40	0.35				
						41	0.26				
						42	0.55				
						43	0.39				
						101	0.47				
						102	11.20				
						103	1.62				
						104	0.87				
						105	1.62				
						106	1.32				
						238	0.20				
						240	0.22				
						241	0.23				
						244	0.21				
						245	0.21				
						246	0.20				
						247	0.20				
						248	0.20				
						249	0.20				
						250	0.20				
						251	0.20				
						252	0.21				
						253	0.20				
						254	0.21				
						255	0.21				
						256	0.21				
						257	1.32				
						258	1.12				
						259	1.05				
						260	0.89				
						261	0.85				
						262	0.80				
						263	0.72				
						264	0.60				
						265	0.54				
						266	0.51				
						267	0.52				
						268	0.55				
						270	0.56				
						271	0.18				
						272	0.35				

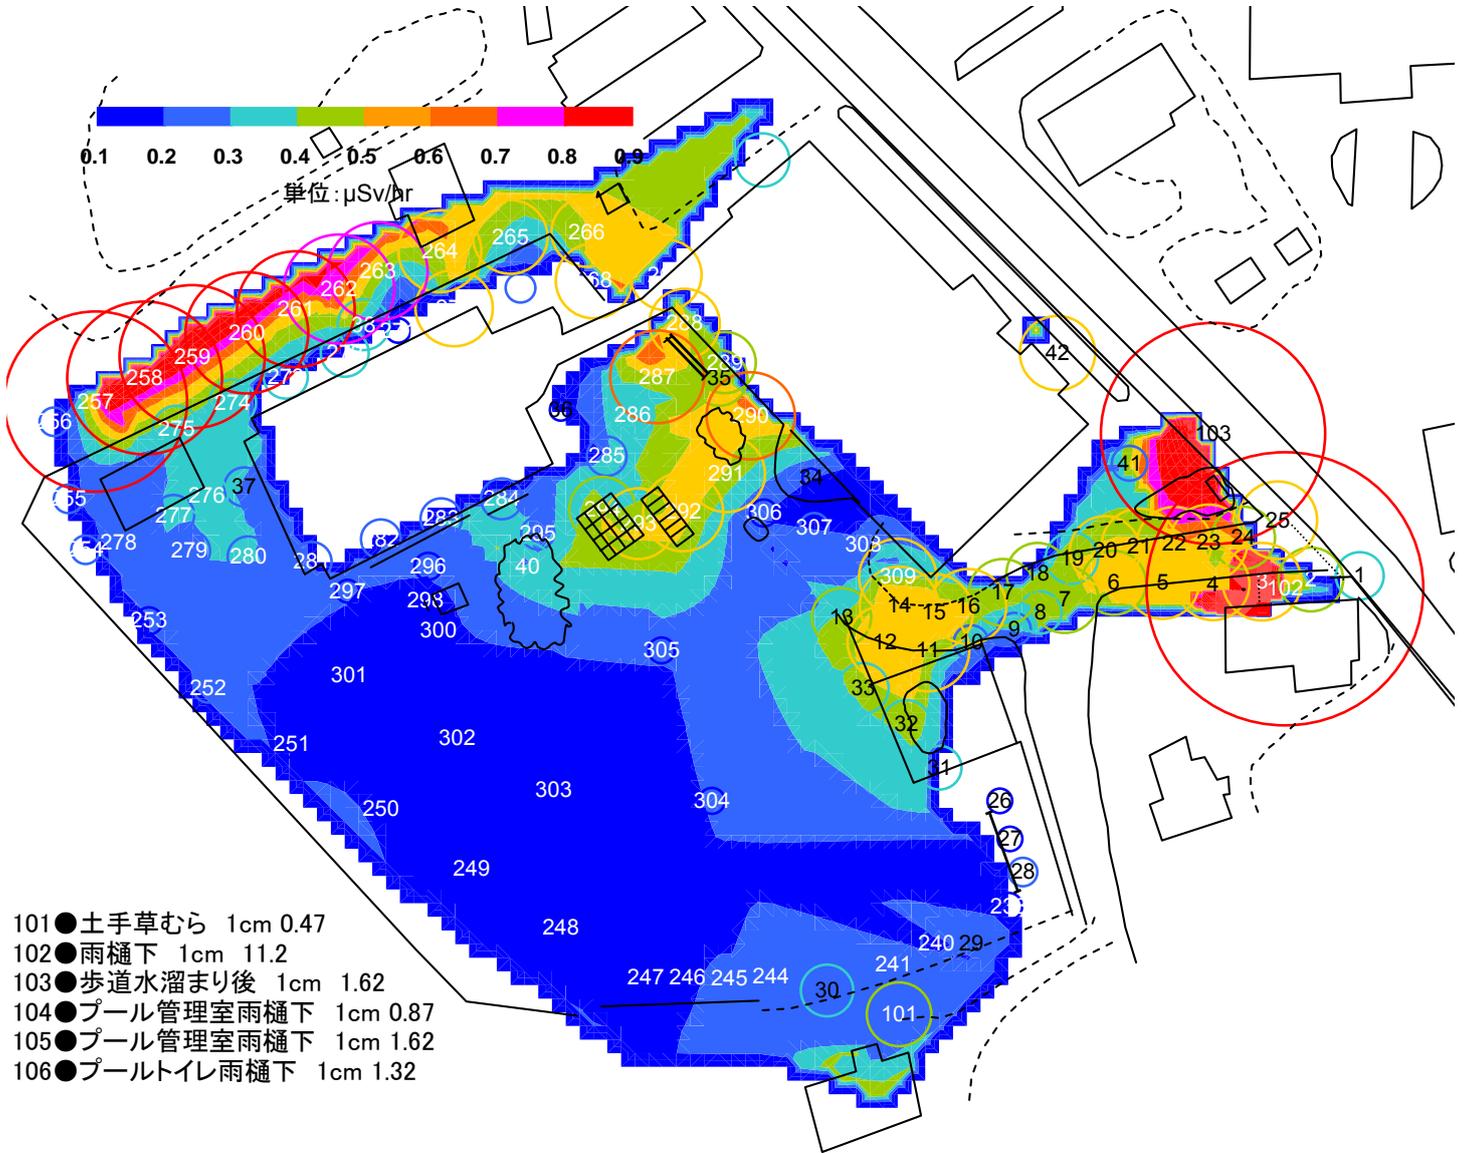