


田村市都路町第7行政区放射線モニタリング結果

測定区分	除染前	測定日	平成23年11月11日(金)
測定地区	みやこ旅館	測定時間	8:00~17:00
測定点	1cm	測定者	橋本利重、吉田幸弘
測定器	Polimaster PM-1405	記録作成	橋本利重、橋本重治
※Polimaster PM-1405は、(株)ホト・ソリューションズ (022-342-8727) の提供協力品です。			

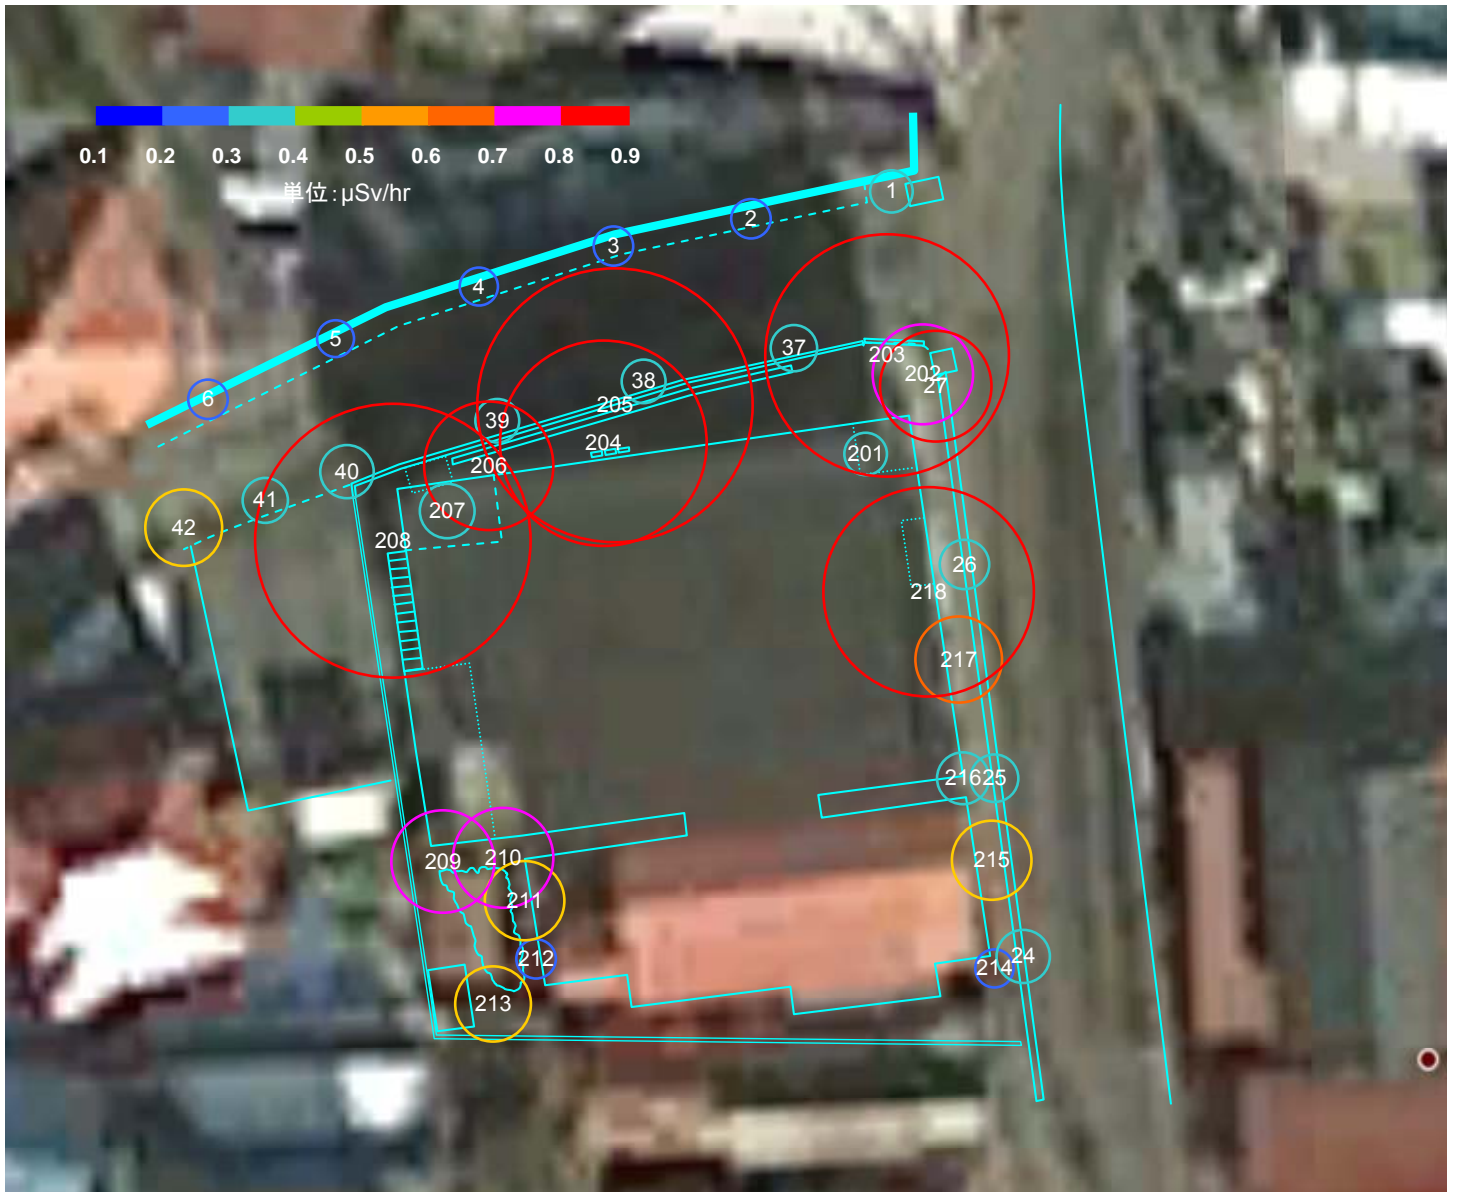

幾何平均		除染前	0.52	$\times \div$	1.95	除染後	$\times \div$	再除染後	$\times \div$	除染%								
No	除染前	除染後	除染%	再除染後	除染%	No	除染前	除染後	除染%	再除染後	除染%	No	除染前	除染後	除染%	再除染後	除染%	
1	0.31					204	1.50					224						
2	0.29					205	2.51					225						
3	0.29					206	0.94					226						
4	0.28					207	0.40					227						
5	0.27					208	2.92					228						
6	0.29					209	0.75					229						
24	0.39					210	0.73					230						
25	0.35					211	0.58					231						
26	0.36					212	0.29					232						
27	0.81					213	0.55					233						
37	0.34					214	0.28					234						
38	0.32					215	0.58					235						
39	0.32					216	0.38					236						
40	0.39					217	0.63					237						
41	0.33					218	1.53					238						
42	0.56					219						239						
101						220						240						
201	0.31					221						241						
202	0.73					222						242						
203	1.77					223						243						